



It is unlawful to break seals on company meters or to disconnect meters from service without notifying the service connection division on telephone number (317) 261-8133. (see section 555)

Electricity used on construction services shall be metered. Services that have been disconnected by the company are to be restored only by AES Indiana's personnel. Unmetered circuits and jumpered meter bases will be disconnected, an energy diversion charge, and pro-rated billing will be assessed. (see section 555)

It is unlawful to attach and/or mount any customer owned equipment, wire, cable, lights, signs, etc. To any of AES Indiana's facilities without obtaining an attachment permit. (see section 180)

"Holey Moley sez"

Don't dig blind



Electric
Gas or oil
Communications
Potable water
Sewer
Reclaimed water & irrigation lines
Temporary survey markings
Proposed excavation

Red
Yellow
Orange
Blue
Green
Purple
Pink
White

All of the following information is needed when calling [Indiana 811](#):

County
Township
Street address
Type of work
Extent of work
Name of caller and title


Telephone number
Best time to call
Start date and start time
Contractor
Contractor address




Call two working days before you dig

[Underground plant protection information](#)

Toll free
call 811
before you dig

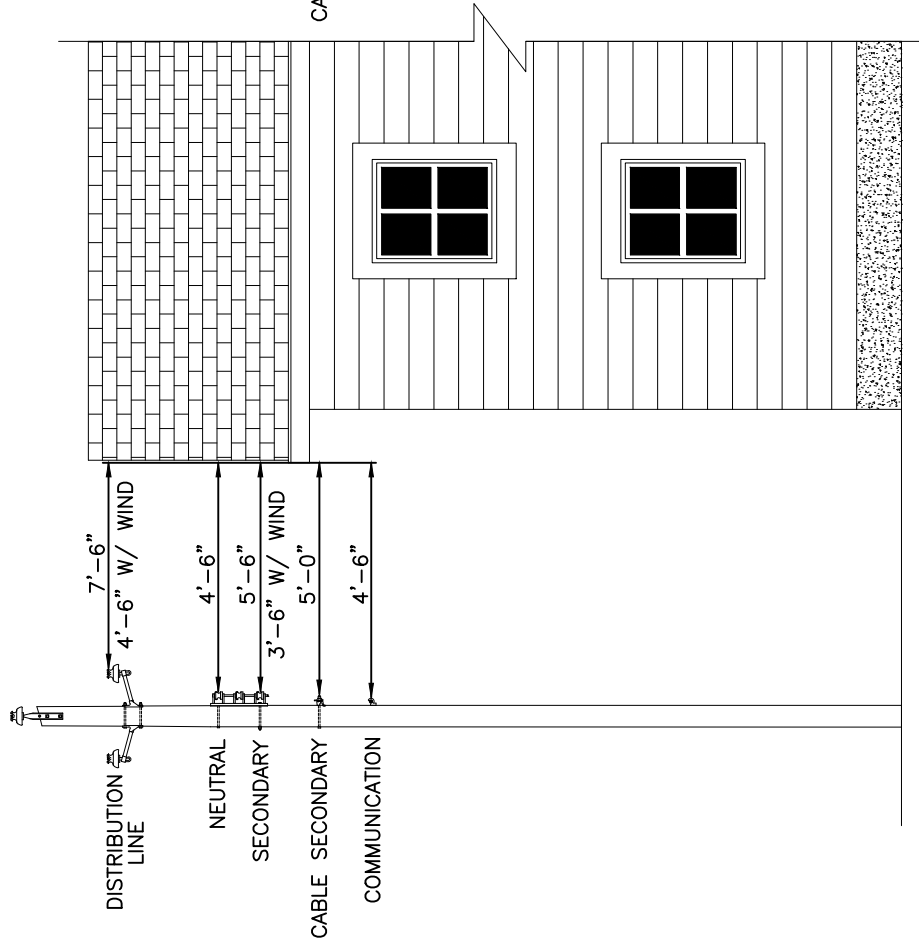

NESC HORIZONTAL CLEARANCES OF WIRES, CONDUCTORS AND CABLES FROM BUILDINGS

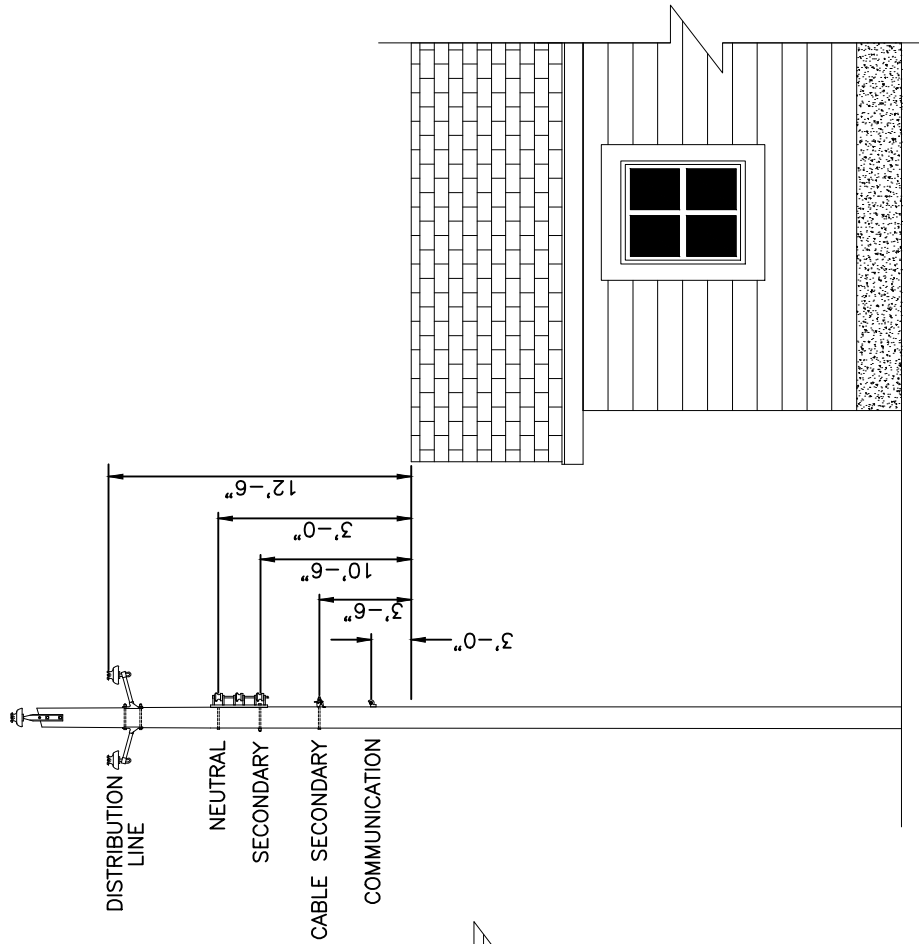

NESC VERTICAL CLEARANCES OF WIRES, CONDUCTORS AND CABLES FROM BUILDINGS

CODE CLEARANCES

- ▲ THE INDIANAPOLIS POWER & LIGHT COMPANY IS CONCERNED ABOUT YOUR SAFETY AND THE SAFETY OF THE PUBLIC. THE DIMENSIONS IN THE ABOVE DRAWINGS ARE MINIMUM CLEARANCES THAT SHALL BE MAINTAINED AFTER CONSTRUCTION OF YOUR PROJECT. THE NATIONAL ELECTRICAL SAFETY CODE IS THE LAW IN THE STATE OF INDIANA AND THE DIMENSIONS SHOWN SHALL BE OBSERVED. GENERALLY, THE OVERHEAD HIGH VOLTAGE WIRES ARE NOT INSULATED FROM CONTACT.
- ▲ DURING CONSTRUCTION OF YOUR PROJECT AND THE LINE IS A DISTRIBUTION LINE (NOT A TRANSMISSION LINE), STAY AT LEAST 10 FEET AWAY. THIS CLEARANCE DISTANCE IS 20 FEET FOR CRANES AND DERRICKS USED IN CONSTRUCTION UNLESS YOU HAVE TAKEN OSHA-MANDATED ENCROACHMENT PREVENTION PRECAUTIONS. IF YOU ARE UNSURE OF THE POWER LINE'S VOLTAGE, CONTACT THE INDIANAPOLIS POWER & LIGHT COMPANY BEFORE WORK BEGINS. FOR SPECIFIC CLEARANCE REQUIREMENTS VISIT WWW.OSHA.GOV.
- ▲ IF THE INDIANAPOLIS POWER & LIGHT COMPANY OVERHEAD LINES ARE CLOSE TO YOUR STRUCTURE, PLEASE CALL (317) 261-8196 IN ORDER TO ENSURE SAFETY AND COMPLIANCE WITH THE NATIONAL ELECTRICAL SAFETY CODE AND OSHA REGULATIONS.



The following information is required for electric service from the company. All fields are mandatory.

Service address _____

Zip code _____

Customer name (Bill payer when the service is initially energized) _____

Mailing address _____

Mailing city/state/zip code _____

Federal tax ID _____

Is this a registered business in the state of Indiana? Yes **You must be registered.** Please do so at <https://www.in.gov/sos/business/>. Contact the IPL business line on (317) 261-8444 if you have questions. No

Responsible party (To answer questions regarding the bill). _____

Phone number _____

Service size amperes _____

Service type 1Ø, 3-Wire 3Ø, 4-Wire Wye 3Ø, 4-Wire Delta

Voltage 120/240 V 120/208 V 277/480 V

kW Load _____

Permanent Temporary

Owner Tenant

Date wanted (service ready?) _____

Date of full operation _____

Electrician's company name _____

Electrician's name _____

Phone number _____

Form completed by: _____

Title/role: _____


Commercial / industrial information sheet

Work management

- The flow chart below is an essential tool in helping our customers and Project Designers arrive at an accurate project completion date.
- Since each project is unique, the requirements for successful project completion will vary.
- Please keep in mind that requirements such as easements and railroad crossings require longer lead times and have the potential to greatly affect the timeliness of the project.
- AES Indiana's Project Designers will work with you to determine these requirements as well as the expected project completion date.


Potential causes for delay

- Delays in Project Designer receiving site plans on time.
- Delays in receiving customer load and/or billing information.
- Not obtaining an easement in a timely manner.
- Not obtaining necessary permits.
- Weather delays - excessive rain or storms in our service territory and surrounding area.
- Failure to place Self Certification/City-Inspection Tag in meter equipment.

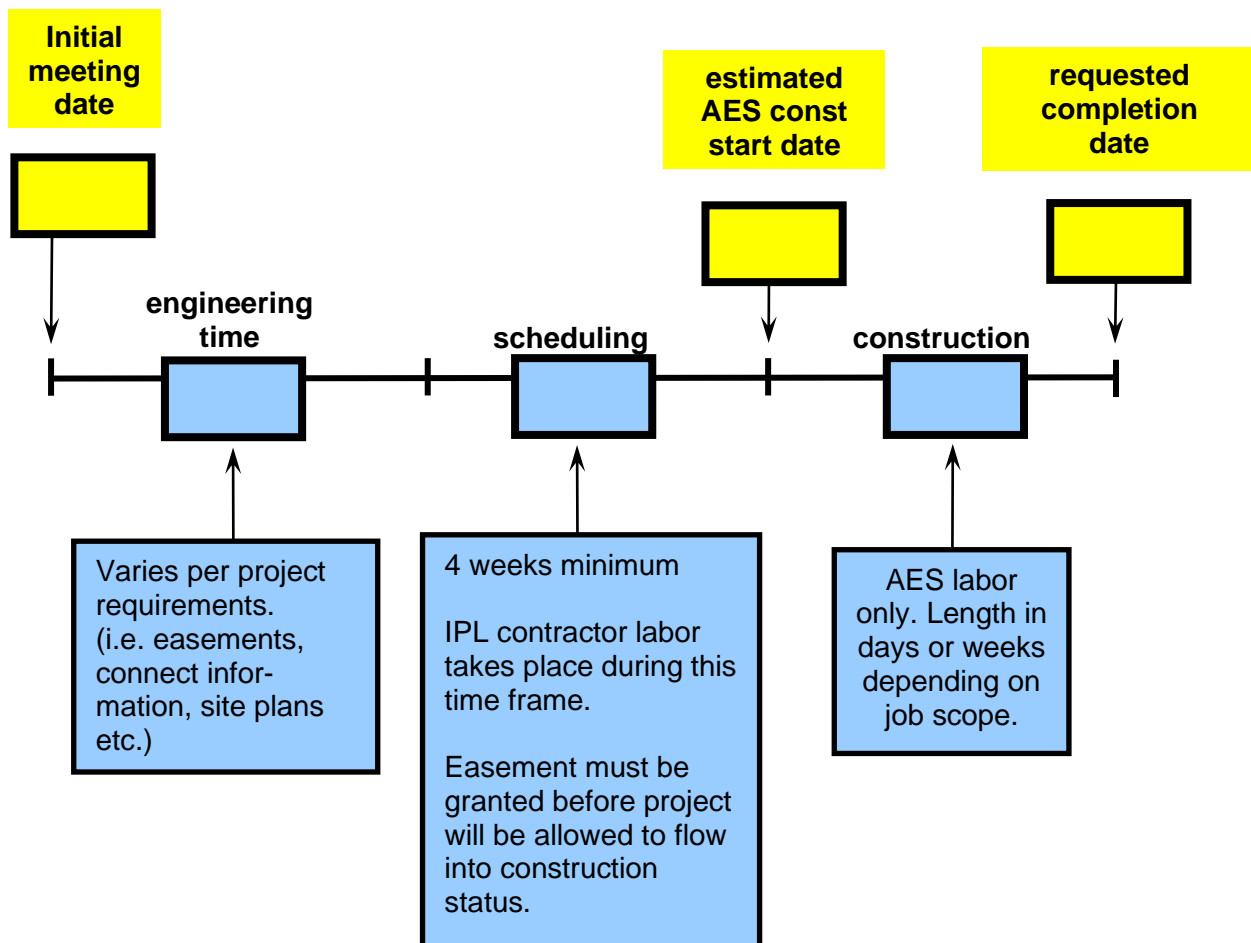



**NORTH DISTRICT
TEAM LEADER
Dan Davenport
(317)261-5497**

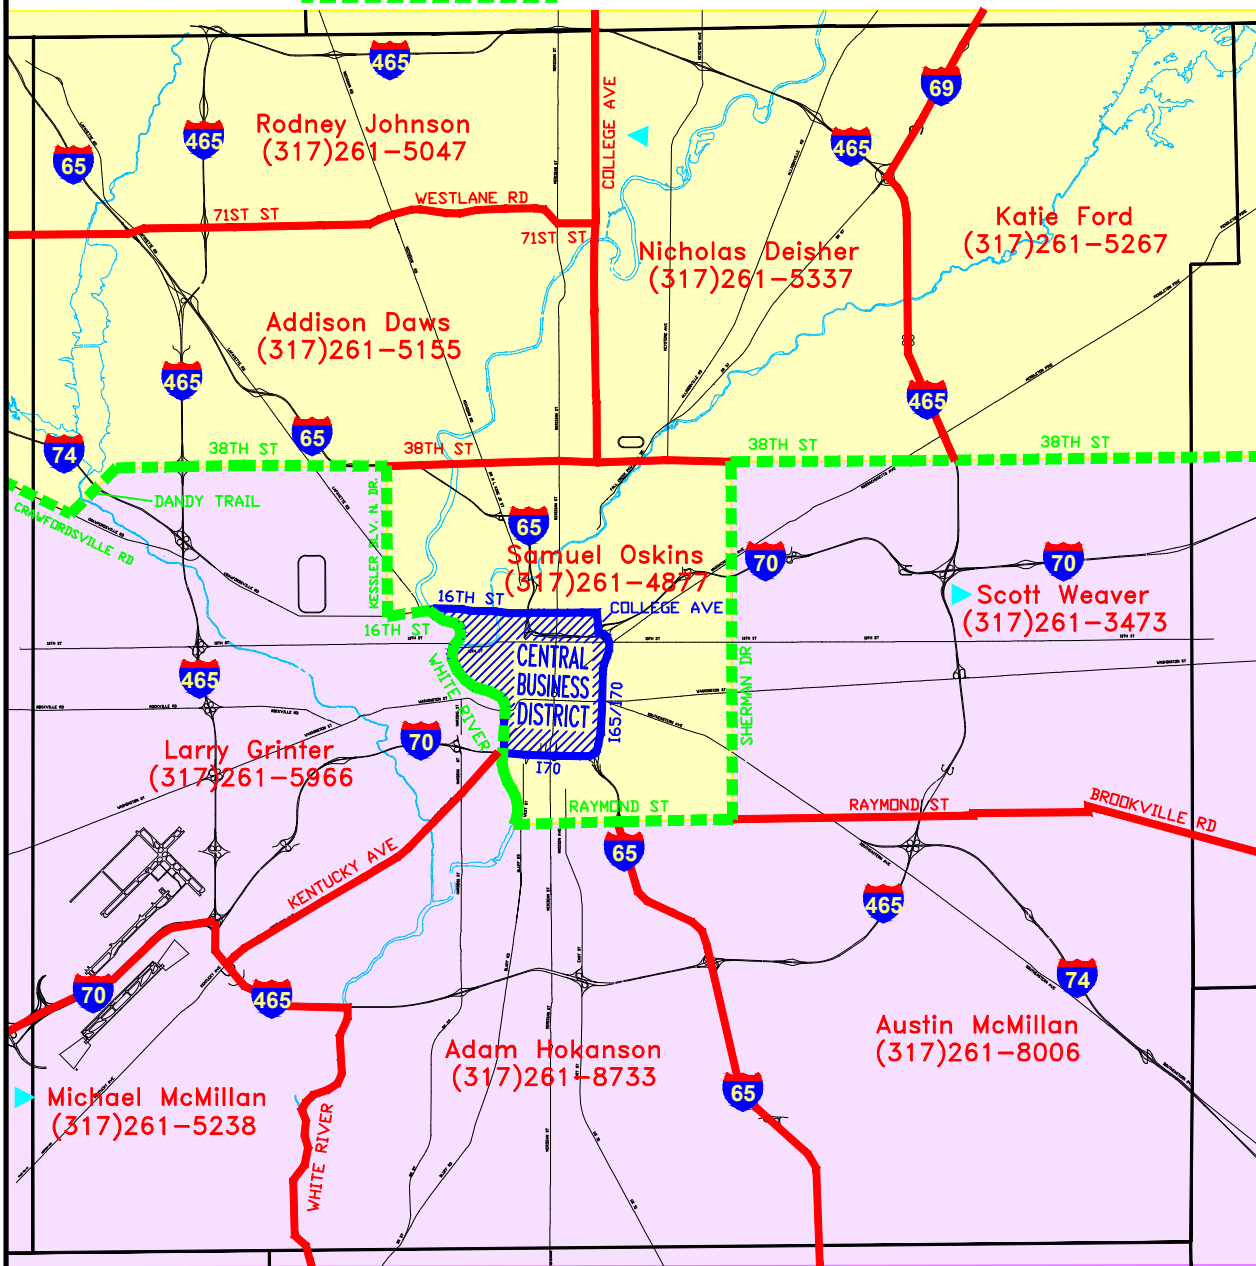

**SOUTH DISTRICT
TEAM LEADER
Scott Weaver
(317)261-3473**

**MAJOR OVERHEAD PROJECTS
MANAGER
David Skeem
(317)261-3480**


Nicholas Allen (317)261-5157
 Aaron Bruner (317)261-3474
 Steve Bullock (317)261-6527
 Jim Disman (317)261-6578
 Jim Duvall (317)261-8694
 Terry Short (317)261-8732
 Brenton Vogt (317)261-8085

MAJOR UNDERGROUND PROJECTS

**For Central Business District
please refer to drawing GB0-110.**

NOTE:
EMAIL ADDRESS FORMAT IS
firstname.lastname@aes.com

**CUSTOMER PROJECTS
ENGINEERING DISTRICT MAP**

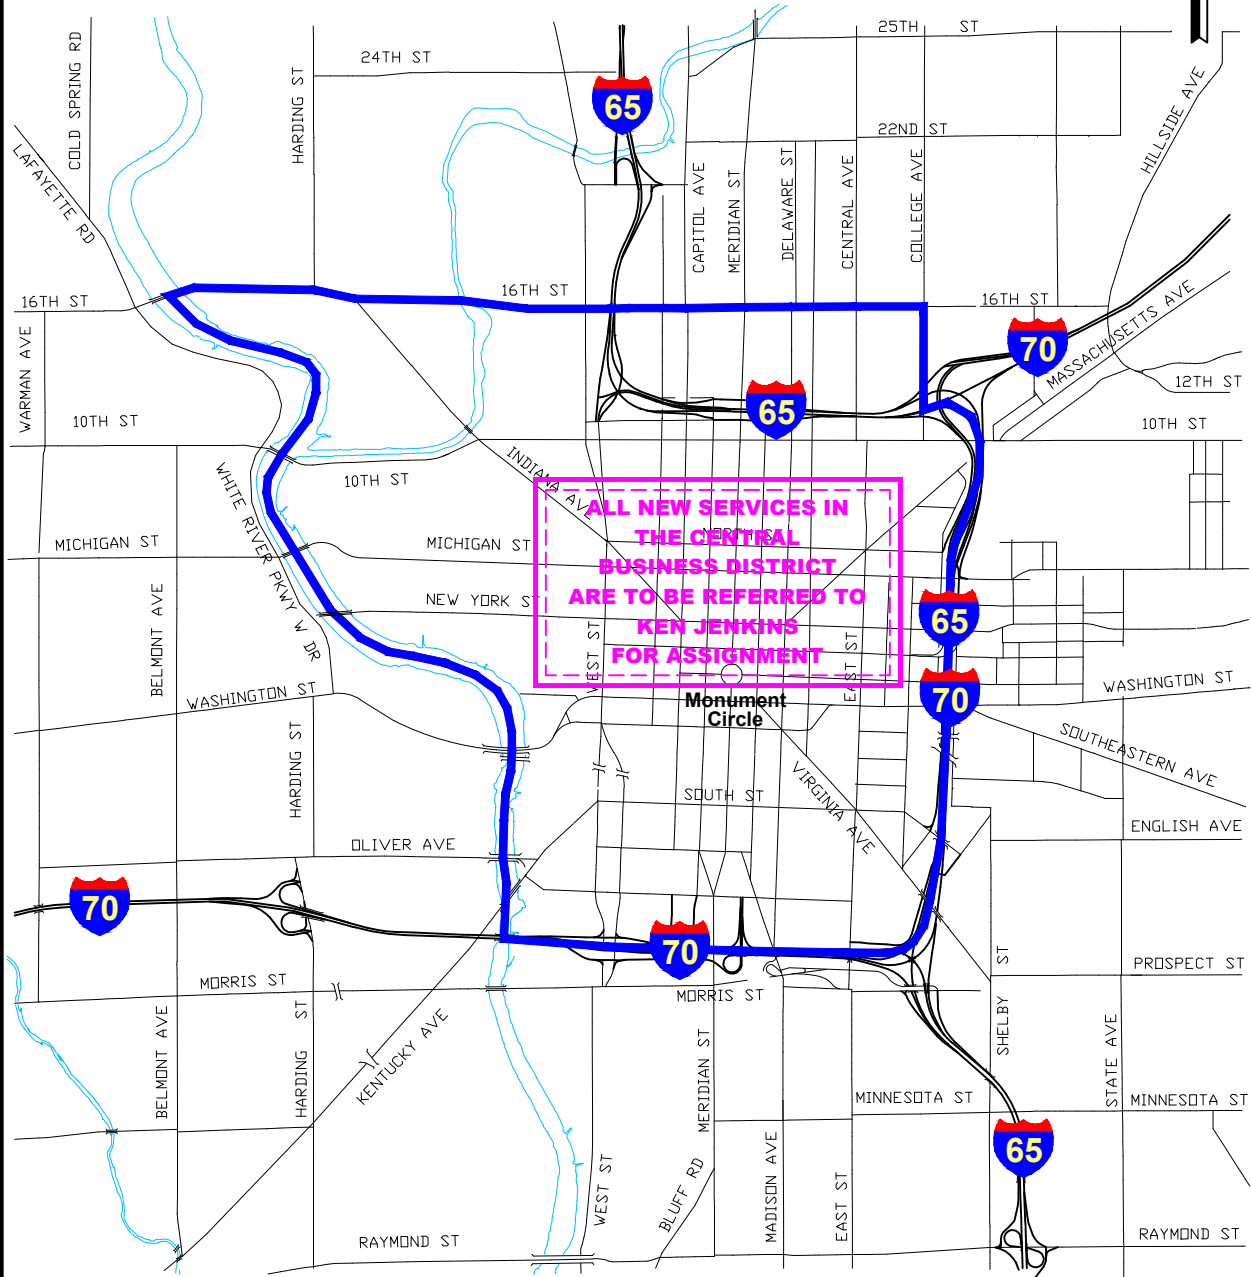

**FIRST CONTACT PERSON
FOR NEW SERVICES**
Ken Jenkins
(317)261-5193

David Lufcy (317)261-8955
▶ Shivam Sharma (317)261-5171
Rob Wall (317)261-5277

NOTE:
EMAIL ADDRESS FORMAT IS
firstname.lastname@aes.com

CENTRAL BUSINESS DISTRICT ENGINEERING DISTRICT MAP

MAJOR UNDERGROUND PROJECTS ENGINEERING TEAM



Distributed generation contact information

Level I applications (10 kW or Smaller)

First Contact:

Aaron Bruner, Major Distribution Projects Engineering, (317) 261-3474

Matthew Fields, Marketing and Program Management, (317) 261-3421

Justin Sufan, Regulatory Affairs, (317) 261-6629

Level II and III applications (Over 10 kW)

First Contact:

Account management executives shown on drawing GB0-120

Technical

Robert Grubb, Planning, (317) 261-5714


Regulatory

Justin Sufan, Regulatory Operations, (317) 261-8072

NOTE:

EMAIL ADDRESS FORMAT IS


firstname.lastname@aes.com

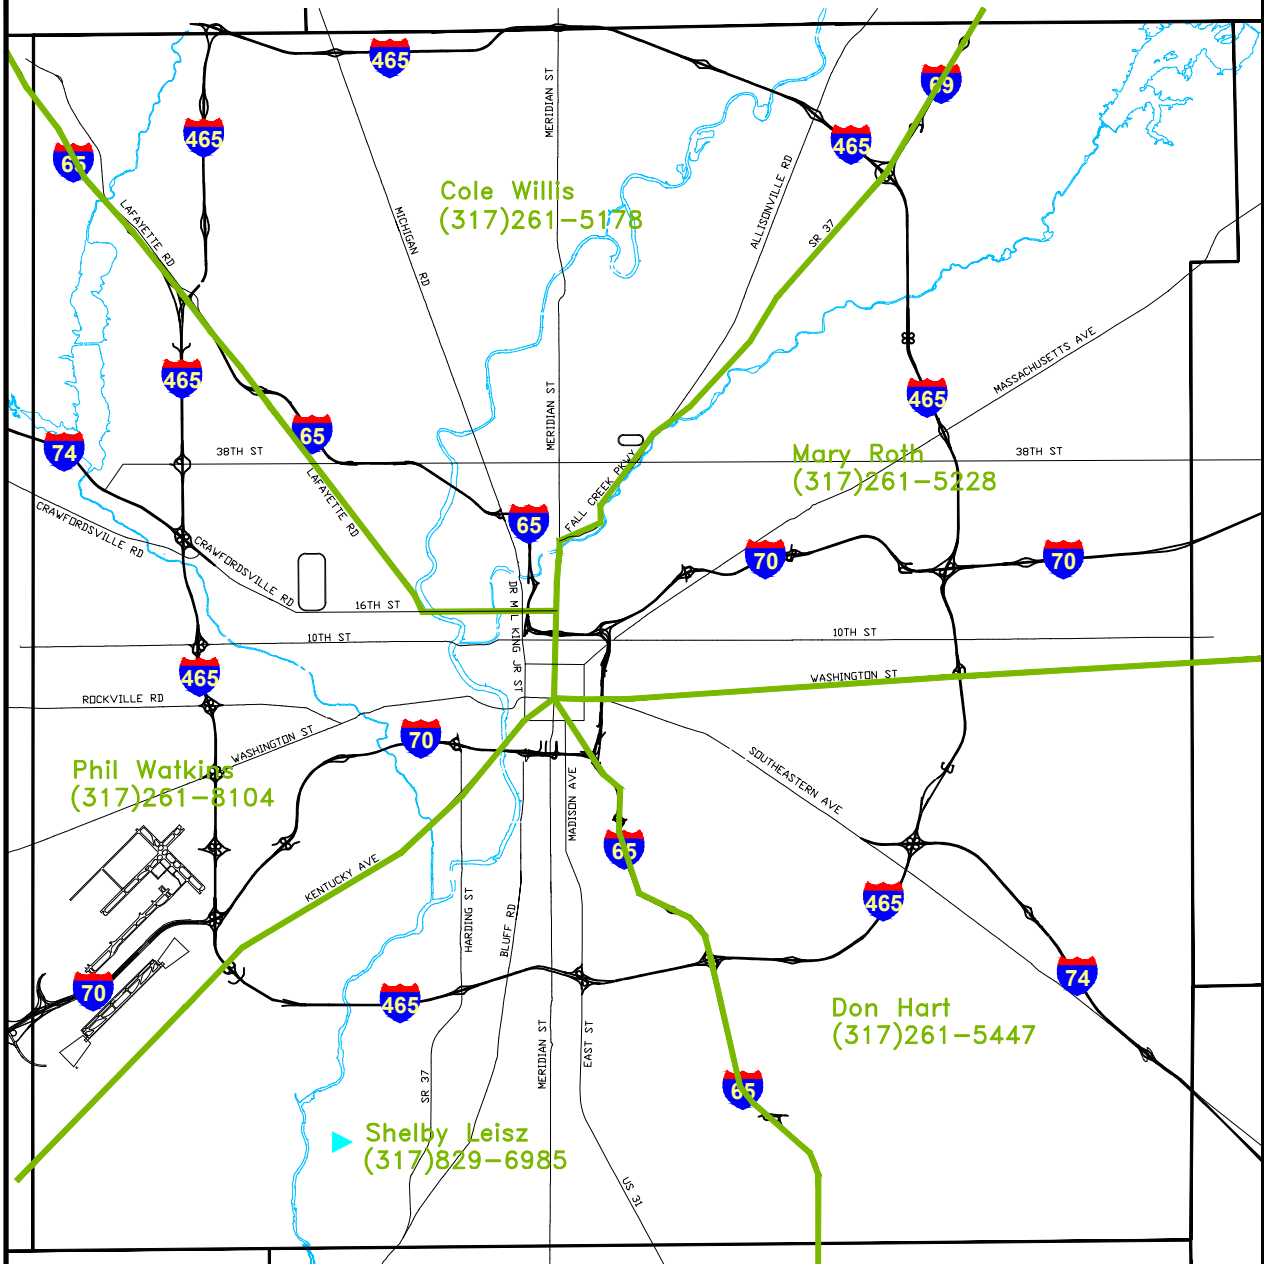

NOTE:

EMAIL ADDRESS FORMAT IS
firstname.lastname@aes.com

ACCOUNT MANAGEMENT EXECUTIVES

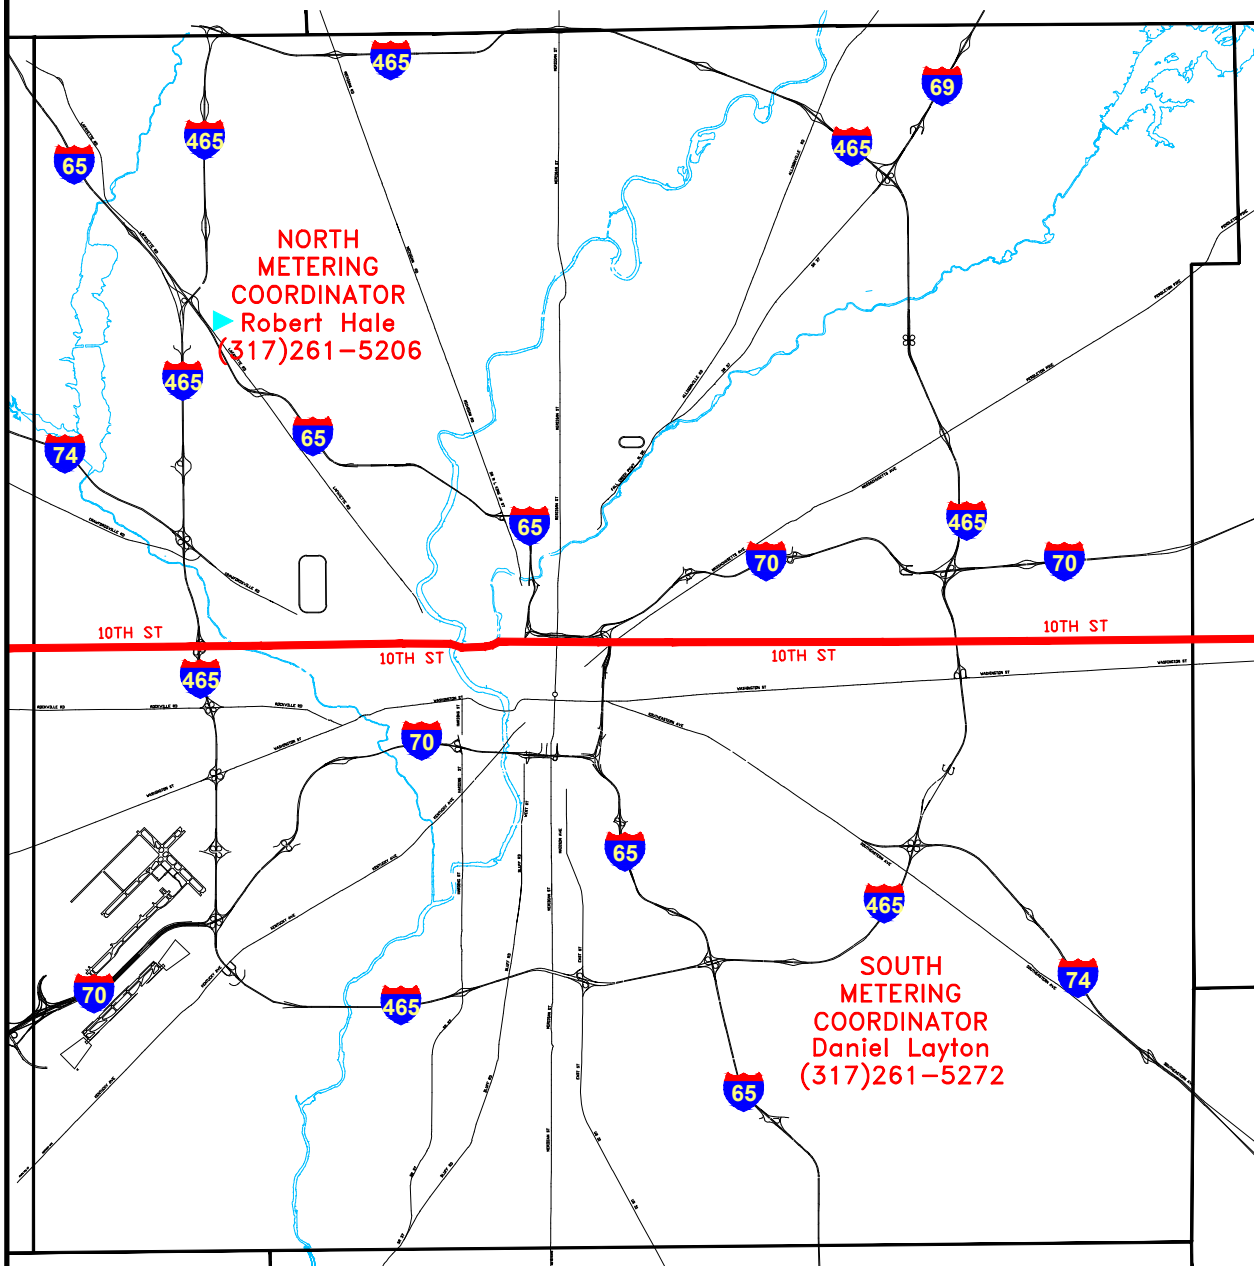


**CUSTOMER SERVICE
METERING
TEAM LEADER**
Anthony Broderick
(317)261-5262

NOTE:

EMAIL ADDRESS FORMAT IS
firstname.lastname@aes.com

**METER INSTALLATIONS
DISTRICT MAP**

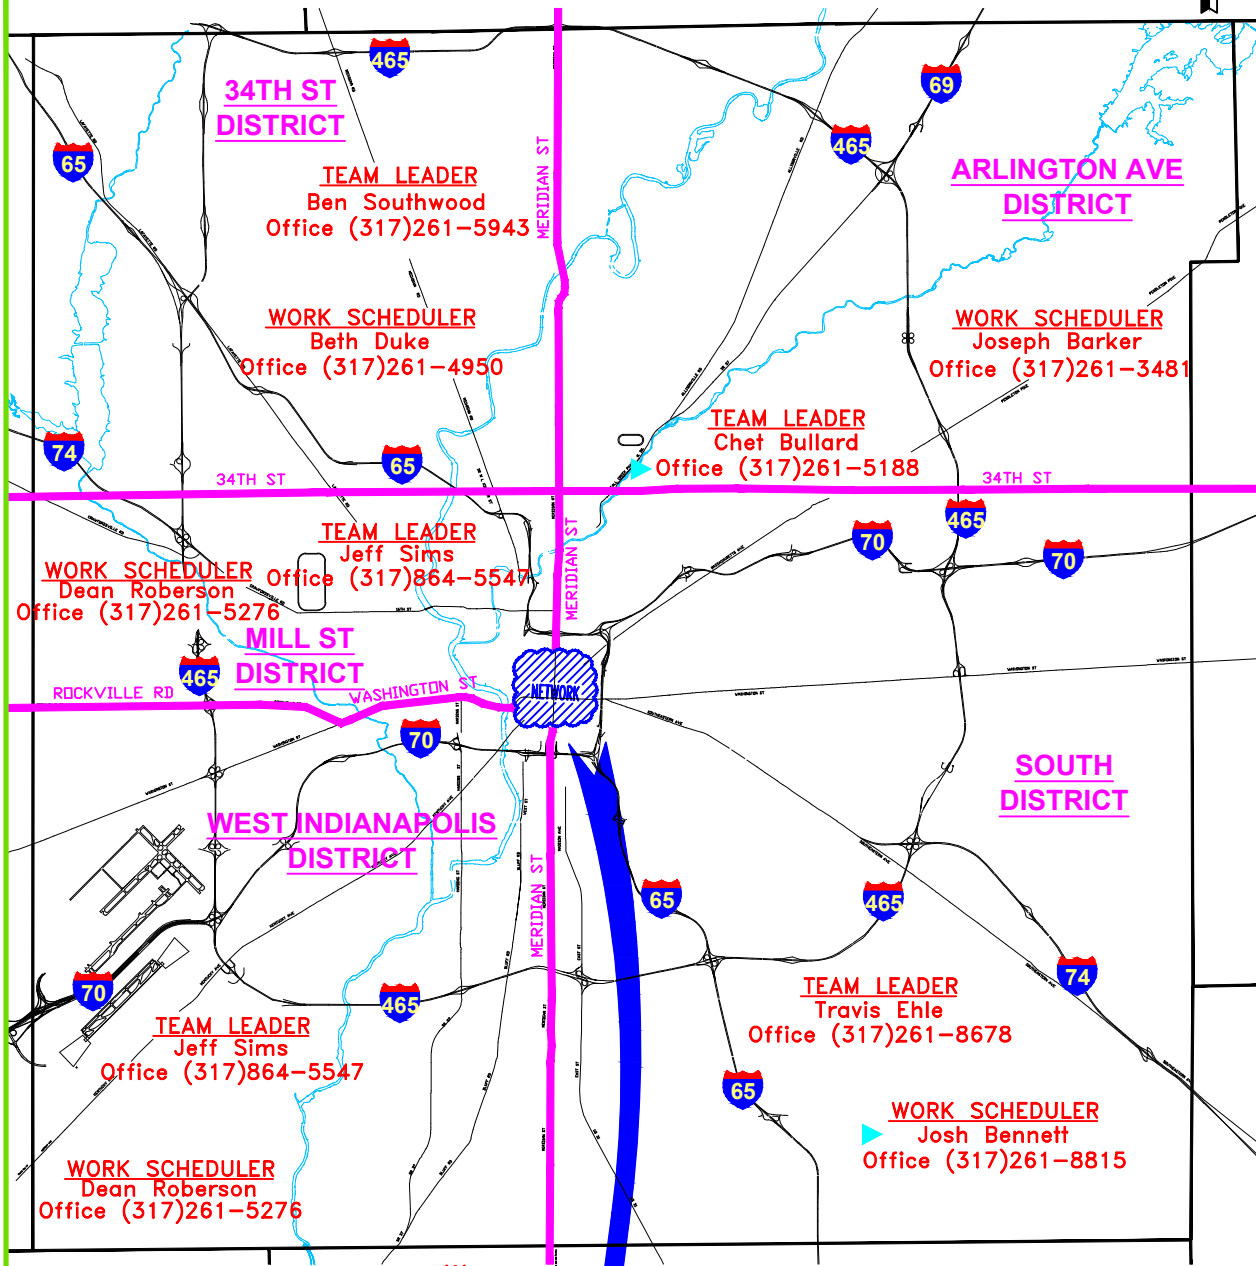

NOTE:


Please contact the engineering department first regarding new or altered services, or other powerline questions. Refer to pages GB0-100 and GB0-110.

DOWNTOWN NETWORK
TEAM LEADERS
 Caesar Doyle (317)261-8522
WORK SCHEDULER
 Karen Long (317)261-8224

NOTE:

EMAIL ADDRESS FORMAT IS
 firstname.lastname@aes.com

**CONSTRUCTION AND MAINTENANCE
 DISTRICT MAP**

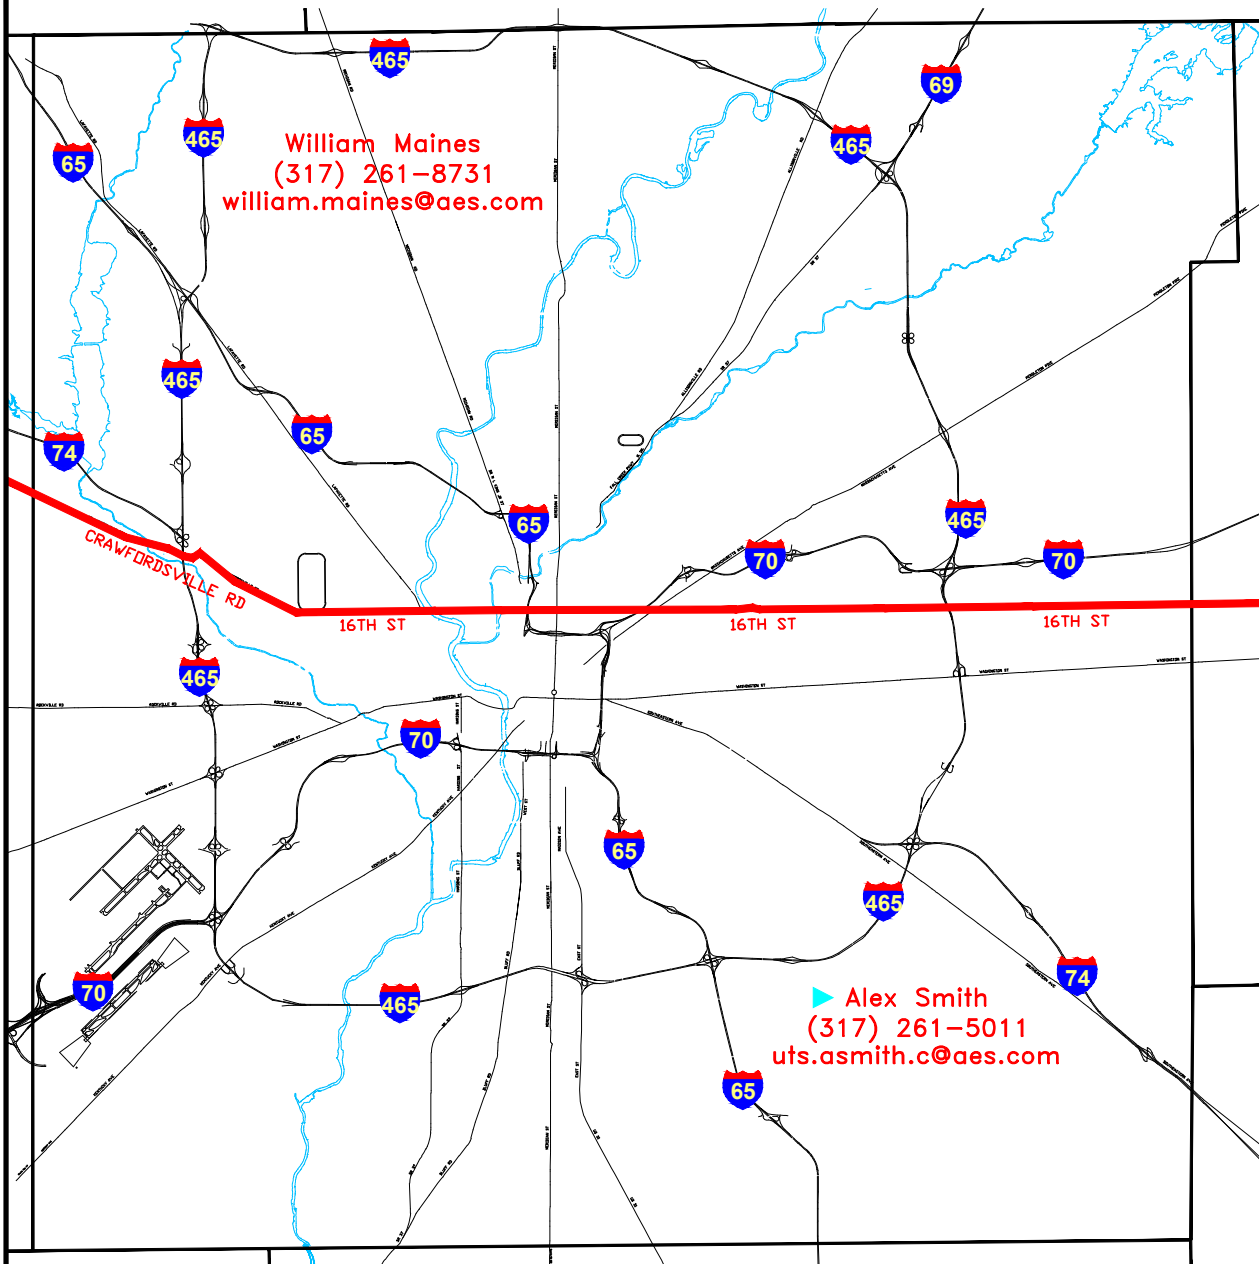

TEAM LEADER
▶ Michael Schaefer
(317) 261-5097
michael.schaefer@aes.com

CONVERSION FROM AN OVERHEAD SERVICE DROP TO AN UNDERGROUND SERVICE LATERAL.

NEW SINGLE LOT UNDERGROUND SERVICE INSTALLATIONS.

UNDERGROUND SERVICE LATERAL RELOCATIONS.

RESIDENTIAL SERVICE INSTALLATIONS 400 AMPERES AND BELOW



Michael Schaefer
(317) 261-5097
Team leader

**Residential service installations and
small commercial (non-CT metered) installations**

Covers the entire Company service
territory for the service connection crews

Monsanto Love
(317) 261-8672
Team leader

**Underground construction
except for residential services**


Covers the entire Company service territory

Note:
email address format is
firstname.lastname@aes.com

**Residential service installations and
small commercial (non-CT metered)
installations**

REV 02/16/21

GB0-160

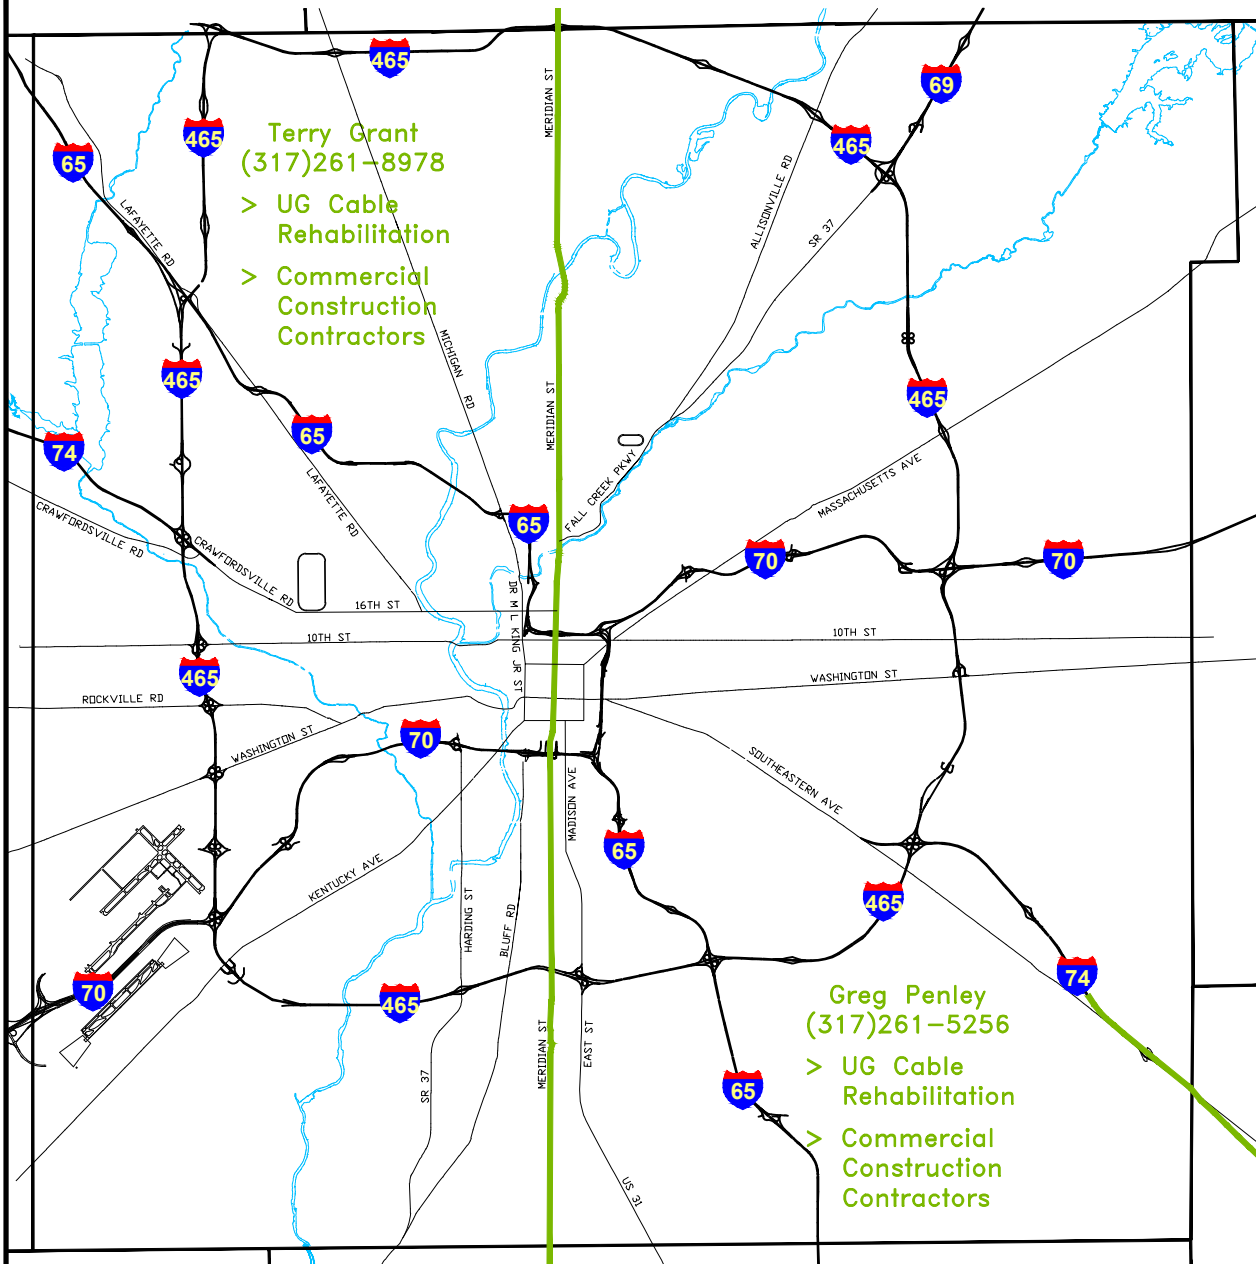

TERRITORY WIDE RESPONSIBILITIES


Terry Grant
- Service Installation Contractors

Greg Penley
- URD Construction Contractors

NOTE:

▶ EMAIL ADDRESS FORMAT IS
firstname.lastname@aes.com

CONTRACT COORDINATOR RESPONSIBILITIES

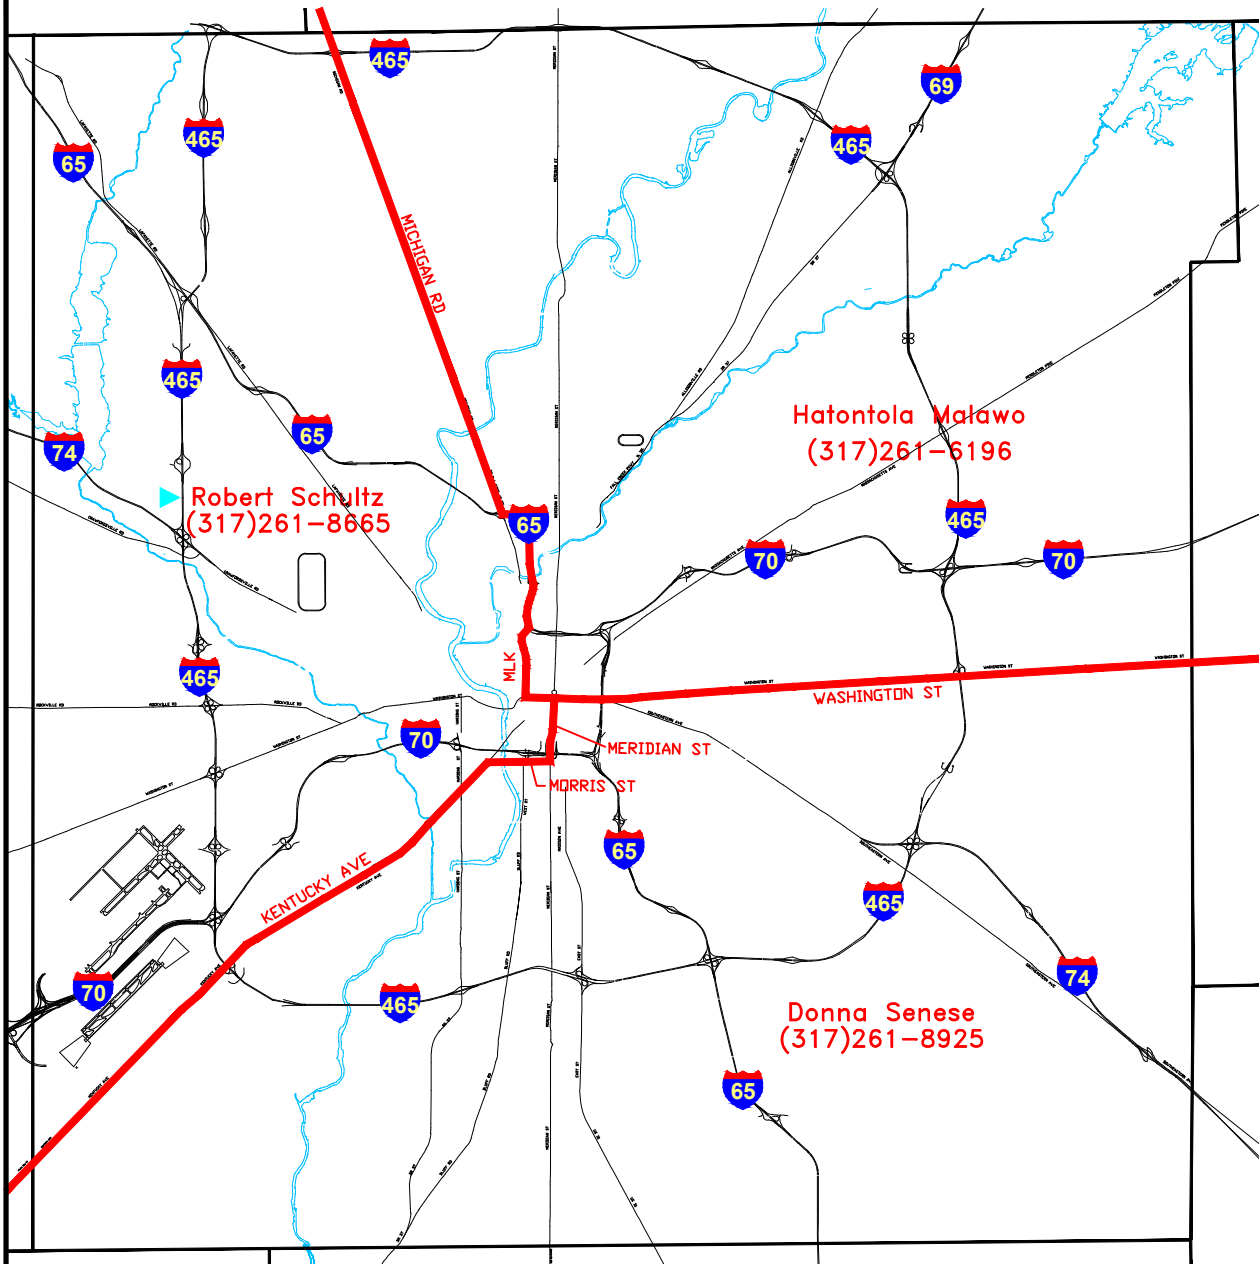

**CONSTRUCTION & MAINTENANCE
CONTRACTOR COORDINATOR**

Jacob Lapis
(317)261-8025


LIGHTING DESIGN TEAM LEADER

Jordan Watkins
(317)261-8096

NOTE:

EMAIL ADDRESS FORMAT IS
firstname.lastname@aes.com

**STREET LIGHTING
DISTRICT MAP**

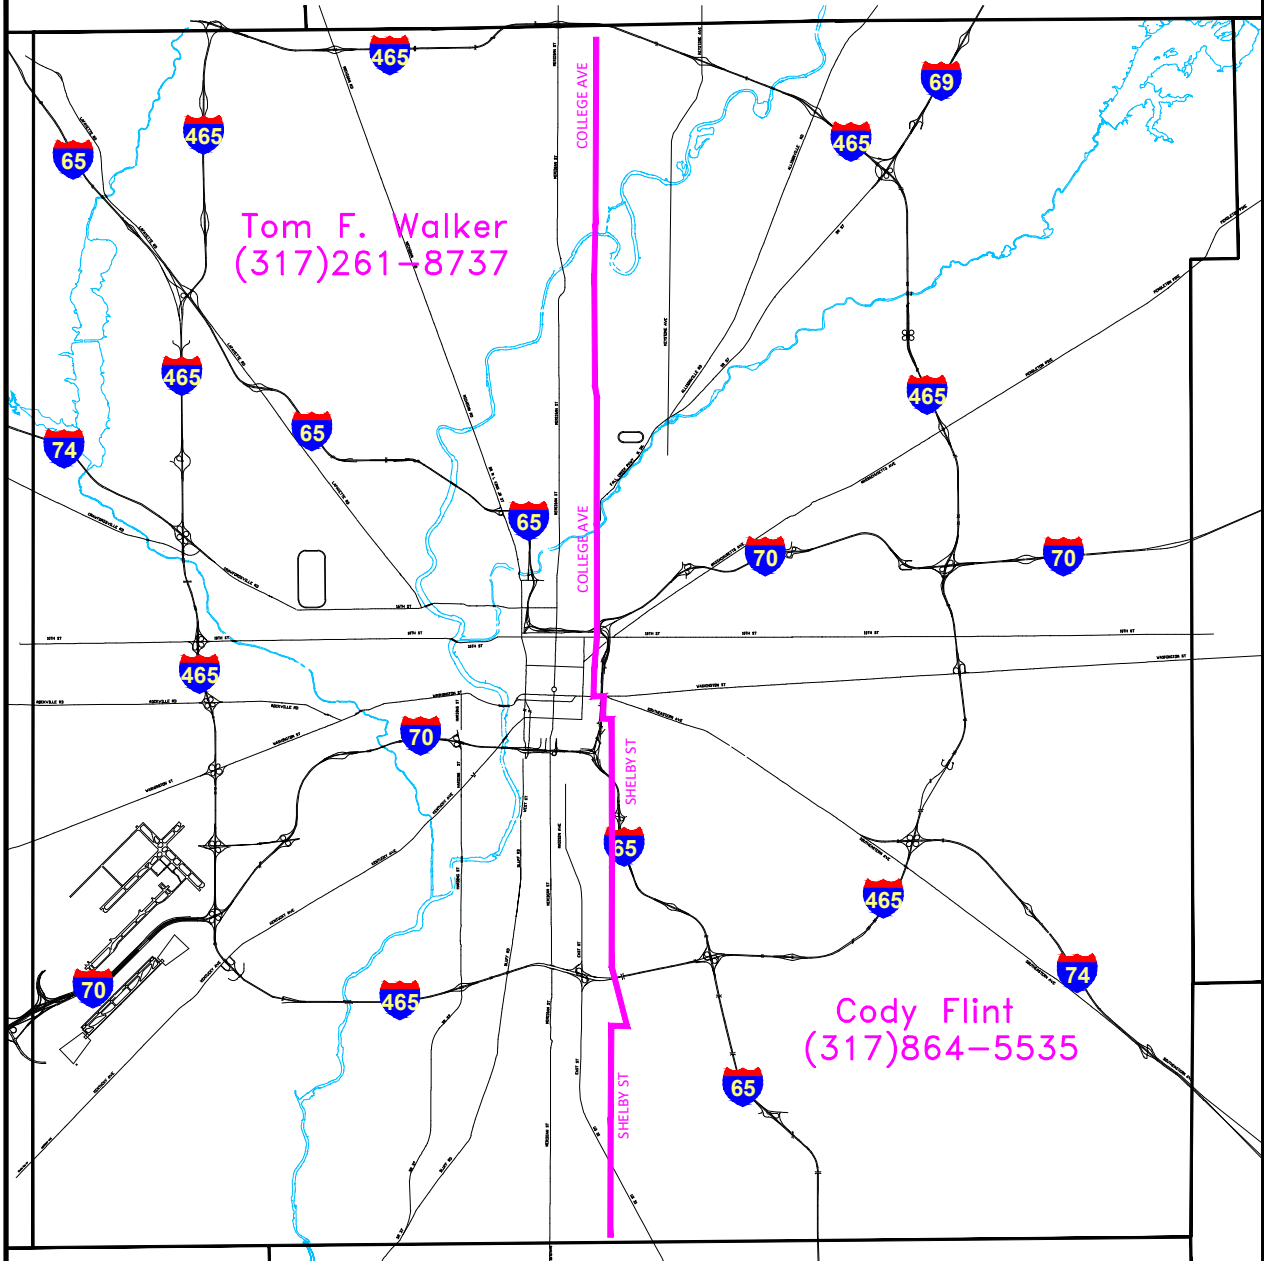

Tree Trimming
Team Leader
Daniel Perry
(317)261-8124

NOTE:

- ▶ EMAIL ADDRESS FORMAT IS
firstname.lastname@aes.com

TREE TRIMMING COORDINATORS